

Wireless Smoke Alarm

User's Manual

V1.0.0

ZHEJIANG DAHUA VISION TECHNOLOGY CO., LTD .

Address: No.1199 bin'an Road, Binjiang District, Hangzhou, P. R. China | Postcode: 310053
 Website: www.dahuasecurity.com | Email: overseas@dahuatech.com
 Tel: +86-571-87688883 | Fax: +86-571-87688815

Foreword

General

This manual introduces the functions and operations of the Wireless Smoke Alarm (hereinafter referred to as "the Alarm").

Safety Instructions

The following categorized signal words with defined meaning might appear in the manual.

Signal Words	Meaning
CAUTION	Indicates a potential risk which, if not avoided, could result in property damage, data loss, lower performance, or unpredictable result.
NOTE	Provides additional information as the emphasis and supplement to the text.

About the Manual

- The manual is for reference only. If there is inconsistency between the manual and the actual product, the actual product shall prevail.
- We are not liable for any loss caused by the operations that do not comply with the manual.
- The manual would be updated according to the latest laws and regulations of related regions. For detailed information, see the paper manual, CD-ROM, QR code or our official website. If there is inconsistency between paper manual and the electronic version, the electronic version shall prevail.
- All the designs and software are subject to change without prior written notice. The product updates might cause some differences between the actual product and the manual. Please contact the customer service for the latest program and supplementary documentation.
- There still might be deviation in technical data, functions and operations description, or errors in print. If there is any doubt or dispute, please refer to our final explanation.

- Upgrade the reader software or try other mainstream reader software if the manual (in PDF format) cannot be opened.
- All trademarks, registered trademarks and the company names in the manual are the properties of their respective owners.
- Please visit our website, contact the supplier or customer service if there is any problem occurred when using the device.
- If there is any uncertainty or controversy, please refer to our final explanation.

Important Safeguards and Warnings

This manual will help you to use the Device properly. Read the manual carefully before using the Device, and keep it well for future reference.

Operation Requirements



WARNING

- Never ignore any alarm. Failure to respond may lead to serious injury or death.



CAUTION

- Make sure that the power supply of the device works properly before use.
- Use the device according to the operating environment.
- Only use the device within the rated power range.
- Transport, use and store the device under allowed humidity and temperature conditions.
- Prevent liquids from splashing or dripping on the device. Make sure that there are no objects filled with liquid on top of the device to avoid liquids flowing into it.
- The smoke alarm is only designed for indicating the presence of smoke, but it cannot detect gas, heat or flames.

Installation Requirements



WARNING

- Strictly abide by local electrical safety standards, and make sure that the voltage in the area is steady and conforms to the power requirements of the device.
- Failure to properly install and operate this device will prevent proper operation of the Device and will prevent its response to fire hazards.



CAUTION

- Observe all safety procedures and wear required protective equipment provided for your use while working at heights.
- Do not expose the device to direct sunlight or heat sources.
- Keep the original packing material well because you might need it to pack the device and send it back for repair.
- Make sure the application scenario conforms to installation requirements. Contact your local retailer or customer service center if there is any problem.
- All installation and operations shall conform to your local electrical safety requirements, fire protection regulations, and other relevant regulations.

Maintenance Requirements


- Do not clean the device with any cleaning products.
- Do not paint the device. Paint will seal the bents and interfere with the sensor's ability to detect smoke.

1 Introduction

1.1 Product information

Wireless Smoke Alarm provides battery-powered smoke detection and alarm functions within a single unit. Advanced electronics in conjunction with a photoelectric smoke sensing chamber provide early detection of smoke and high immunity against unwanted alarms. This kind of smoke alarm does not require a mains supply and is suitable for general residential applications. Timely notification of the smoke alarm can be displayed on DMSS App in real time.

1.2 Product profile

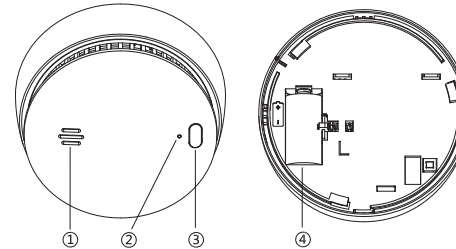

No.	Name	Introduction
1	Buzzer	Alarm Sound: 85dB (A) at 3 m (9.84 ft)
2	Indicator	<ul style="list-style-type: none"> Standby: Green indicator flashes once per minute Alarm: Red indicator flashes once per second Fault: Red indicator flashes once per minute
3	Test/Silence Button	<ul style="list-style-type: none"> Verify the normal working Stop the alarm sound
4	Battery Compartment	Replace the battery

2 Technical Information

Specification	Introduction
Model	DHI-HY-SA21A-W2, DHI-HY-SA21A-W2(868)
Sensor Type	Photoelectric
Supply Voltage	3V CR123A lithium battery (replaceable)
Battery Life	3 years
Alarm Method	Visual and audible alarm
Operating Current	<ul style="list-style-type: none"> Monitoring current: $\leq 35\mu\text{A}$ Alarm current: $\leq 35\text{mA}$
Operating Temperature	-10°C to $+55^{\circ}\text{C}$ ($+14^{\circ}\text{F}$ to $+131^{\circ}\text{F}$)
Operating Humidity	$\leq 95\%$ RH (non condensing)
Detecting Area	When the height of the space is less than 8 m (3.28 ft), the protection area of a device is $20\text{ m}^2\text{--}40\text{ m}^2$
Dimensions	$\Phi 98\text{mm} \times \text{H}43.1\text{mm}$ ($\Phi 3.85" \times \text{H}1.70"$)
Weight (with battery)	140 g (0.30 lb)
Certification	EN 14604:2005+AC: 2008
Carrier Frequency	<ul style="list-style-type: none"> DHI-HY-SA21A-W2: 433.1 MHz–434.6 MHz DHI-HY-SA21A-W2(868): 868 MHz–868.3 MHz

3 Device Installation

3.1 Packing List

Check the package according to the following checklist. If you find device damage or any loss, contact the after-sales service.

Table 3-1 Checklist

Name	Quantity
Wireless Smoke Alarm	1
Positioning Map	1
Self-tapping Screw	2
Expansion Bolt	2
Mounting Plate	1
User's Manual	1


3.2 Installation Position



CAUTION


This device is intended for use in ordinary indoor locations of family living units. Construction and layout of individual dwellings will vary, so this should be regarded as a reference only. For further guidance, please check with your local fire station.

Figure 3-1 Overall layout

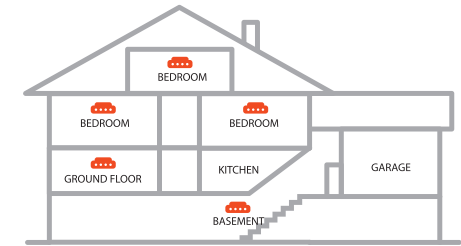



- Installed on the ceiling. If the device is installed on the ceiling, install at a distance of 20 inches (500 mm) away from the corners of the room.

Figure 3-2 Installation position (1)

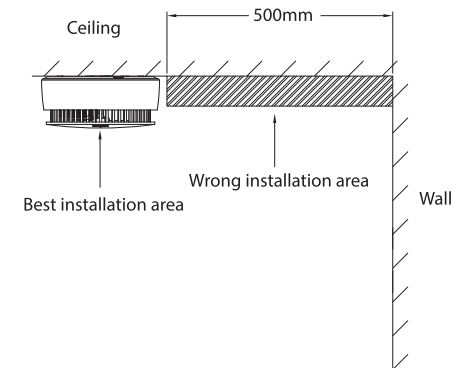

- Installed on the sloping roof. When the slope is less than 45° , the appropriate distance is 20 inches (500 mm). When the slope is more than 45° , a wood should be installed.

Figure 3-3 Installation position (2)

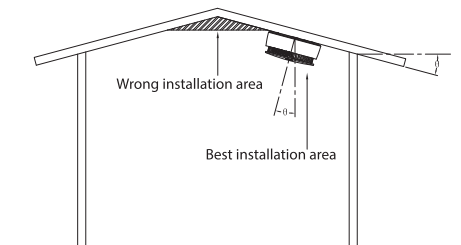

3.3 Installation Steps


Follow below steps to install the device properly.

Step 1 Choose suitable place to install positioning map.

Step 2 Drill holes (Φ6 mm [0.24"]) on the wall as the positioning map shows, and then align the screw holes on the wall with the expansion bolts.

Step 3 Fix the mounting plate with self-tapping screws.

Figure 3-4 Installation step (1)

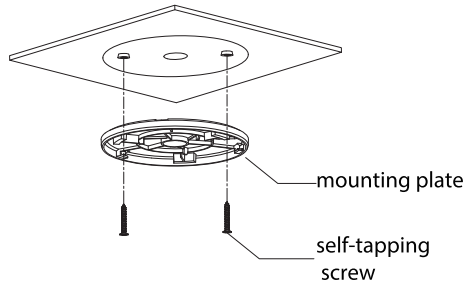

Step 4 Install the Device.


- 1) Correctly insert the lead wires, install the battery into the battery compartment according to the marked positive and negative polarity, and arrange the wiring harness.
- 2) Rotate the device according to the corresponding position and direction as shown in the figure.



NOTE

Please ensure it is firm.

Figure 3-5 Installation step (2)

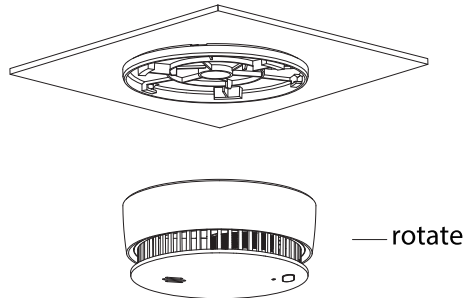

4 Connecting to the Hub

Before you connect it to the hub, install the DMSS app to your phone. Interfaces and functions might vary with different added devices, and the actual interface shall prevail. This manual uses iOS as an example.



- Make sure that you have already created an account, and added the hub to DMSS.
- Make sure that the hub has a stable internet connection.
- Make sure that the hub is disarmed.

Step 1 Go to the **Hub** screen, and then tap **Accessory** to add the Wireless Smoke Alarm.

Step 2 Tap **+** to scan the QR code at the back of the Wireless Smoke Alarm, and then tap **Next**.

Step 3 Select Wireless Smoke Alarm on **Accessory** screen, and tap **Next** after the Wireless Smoke Alarm has been found.

Step 4 Follow the on-screen instructions and switch the Wireless Smoke Alarm to on, press and hold the **Test/Silence** button for 5 s ~10 s and then tap **Next**.

Step 5 Wait for the pairing.

Step 6 Customize the name of the Wireless Smoke Alarm, and select the area, and then tap **Completed**.

5 Smoke Alarm Configuration

You can view and edit general information of the Wireless Smoke Alarm.

5.1 Viewing Status of the Smoke Alarm

On the **Hub** screen, select a Smoke Alarm from the accessory list, and then you can view the status of the Wireless Smoke Alarm.

Table 5-1 Status

Parameter	Description
Signal Strength	The signal strength between the hub and the Wireless Smoke Alarm. <ul style="list-style-type: none"> • : Ultra low. • : Low. • : Moderate. • : High. • : No.
Battery Level	The battery level of the Wireless Smoke Alarm. <ul style="list-style-type: none"> • : Fully charged. • : Sufficient. • : Moderate. • : Insufficient.
Anti-tampering Status	Anti-tampering status of the Wireless Smoke Alarm.
Online Status	Online and offline status of the Wireless Smoke Alarm. <ul style="list-style-type: none"> • : Online. • : Offline.
Relay Status	The status of whether the Wireless Smoke Alarm forwards accessory messages to the hub through the repeater. <p>The function is only available when the version of the DMSS app is 1.96 or later, and the hub is V1.001.0000000.6.R.211215 or later.</p>
Program Version	The program version of Wireless Smoke Alarm.

5.2 Configuring the Wireless Smoke Alarm

On the **Hub** screen, select a Smoke Alarm from the accessory list, and then tap to configure the parameters of the Wireless Smoke Alarm.

Table 5-2 Wireless Smoke Alarm parameter description

Parameter	Description
Device Configuration	<ul style="list-style-type: none"> • View device name, type, SN and device model. • Edit device name, and then tap Save to save configuration.
Area	Select the area to which the Wireless Smoke Alarm is assigned.
Siren Linkage	When an alarm is triggered, the accessories will report the alarm events to the hub and alert with siren.
Alarm-video Linkage	When an alarm is triggered, the accessories will report the alarm events to the hub and then will be linked with videos.
Video Channel	Select the video channel as needed.
LED Indicator	<p>LED Indicator is enabled by default to turn on the LED indicator. For details on indicator behavior, see "1.2Product profile".</p> <p>If LED Indicator is disabled, the LED indicator will remain off regardless of fault or alarm.</p>

Transmit Power	<ul style="list-style-type: none"> • Select from high, low, and automatic. • The higher the transmission power, the farther the transmission and the higher power consuming.
Signal Strength Detection	Test the current signal strength.
Cloud Update	Update online.
Delete	<p>Delete the online accessory.</p> <p>Go to the Hub screen, select the accessory from the list, and then swipe left to delete it.</p>

6 Test and Maintenance

6.1 Test

After the installation of the Device or regular maintenance, a test must be carried out to confirm that the Device is operating properly.

During the testing process, the defective Device should be addressed according to "FAQ" and "Maintenance", and then tested again. If it fails to complete the test successfully, please send the Device to the manufacturer for repair.

Device self-test

Press the **Test/Silence** button, indicator light flashes quickly and buzzer beeps.

Alarm test

When the smoke concentration reaches predetermined threshold, the indicator light flashes and the Device sends out visual and audible alarm. Press **Test/Silence** button to stop alarm sound. When the concentration is lower than the predetermined value, the Device returns to its normal working state.

Low voltage

When the battery voltage is lower than a certain threshold, indicator flashes and the buzzer beeps every minute until the battery is depleted. Please immediately replace the battery with approved types. After replacing the battery, it is recommended to test your smoke alarm every week.

6.2 Maintenance

To keep your device in good working condition, please follow these requirements.

- Simulate fire alarm test: Test the device once a week. Under normal working conditions, press the **Test/Silence** button to ensure that the Device can work normally. If there is a malfunction, please repair it in time. After cleaning, please install the Device and test again.
- Clean the shell: Clean the device at least once per year (recommended). Keep the Device free of dust or inserts by gently vacuuming the shell with a soft brush attachment when required. Avoid cleaning solutions on the Device to prevent the possibility of contaminating the sensor.

7 Battery Replacement

When device has low battery warning, please replace battery immediately. Test the alarm for correct operation using test facility, whenever the battery is replaced. During the replacement, please pay attention to the positive and negative polarity markings. Only the following batteries can be replaced. Use of a battery other than those recommended below may have a detrimental effect on the device's operation.



NOTE


Recommended battery: EVE CR123A, PAIRDEER CR123A, RAMWAY CR123A, LISUN CR123A, HCB CR123A



WARNING

Test the device for correct operation according to EN requirement every time after battery replacement.

Figure 7-1 Battery replacement

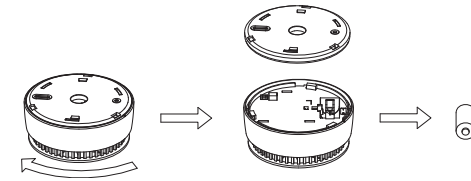

8 FAQ

Problem	Solutions
Your smoke alarm does not sound during testing	<ul style="list-style-type: none"> • If testing immediately after first activating the alarm or replacing the batteries, you should allow a few seconds for the alarm to settle before testing. • Make sure you push the test button firmly. • Make sure you remove the transparent plastic cover of the battery.
Your smoke alarm chirps intermittently	<ul style="list-style-type: none"> • Check the location of your smoke alarm (see "Installation Position"). • Clean the smoke alarm (see "Test and Maintenance").
The LED indicator flashes red and the alarm sounds one beep every 60 seconds	<ul style="list-style-type: none"> • The device is under low battery condition, please replace the battery immediately. • If the problem still exists after battery replacement, please contact technical support for advice.

9 Disposal



Waste electrical products should not be disposed of your other household waste. Please dispose in an environmentally friendly manner, and strictly follow the local regulations regarding the disposal or recycling of the electrical device.



WARNING

Do not burn or dispose of in fire.